Submittal Requirements for PV Systems

1. Site plan (Sheet S1.1) showing location of major components on the property; property lines, setbacks, easements, rights of way, structures, service delivery, etc. This drawing need not be exactly to scale, but it should represent relative location of site components.

2. Electrical diagram showing PV array configuration, wiring system, overcurrent protection, inverter, disconnects, required signs, and ac connection to building.
   a. Choose the applicable *standard electrical diagram and associated forms;* complete all information. If the electrical system is more complex than the standard electrical diagram can effectively communicate, provide an alternative diagram with appropriate detail.
      i. Small Scale, Single Phase Systems
      ii. Micro Inverter Systems
      iii. AC Module Systems
      iv. Supply Side Connection
   b. Diagrams shall identify the number of arrays, the number of strings per inverter, total inverter capacity, ac interconnection point, service disconnect location and means. Interactive PDF diagrams are available at www.solarabcs.org/permitting.

3. Specification sheets and installation manuals (if available) for all manufactured components including, but not limited to, PV modules, inverter(s), combiner box, disconnects, and mounting system. PV modules, utility-interactive inverters, and combiner boxes are identified for use in PV systems.

4. Engineer's structural evaluation where system is adding new live or dead loads to a roof or other structure. The engineer's evaluation shall include the following information:
   a. Mounting System Manufacturer _____
      Product Name and Model#_____
   b. Total Weight of PV Modules and Rails _____lbs
   c. Total Number of Attachment Points_____
   d. Weight per Attachment Point (b÷c)_____
   e. Maximum Spacing Between Attachment Points on a Rail
      _____inches (see product manual for maximum spacing allowed based on maximum design wind speed)
   f. Total Surface Area of PV Modules (square feet)_____ ft2
   g. Distributed Weight of PV Module on Roof (b÷f)_____ lbs/ft2
   h. Summary of the capability of the structure to support the loads and resist wind loading. Provide designs as for needed modifications.

Contractor Name, Address and Phone:	Site Plan for Small-Scale, Single-Phase PV Systems			
_____	Site Name: _____			
_____	Site Address: _____			
_____	System AC Size: _____			
Drawn By:	SIZE	FSCM NO	DWG NO S1.1	REV
Checked By:	SCALE NTS	Date:	SHEET	

SINGLE-PHASE ELECTRICAL DIAGRAM

EQUIPMENT SCHEDULE			
TAG	DESCRIPTION	PART NUMBER	NOTES
1	SOLAR PV MODULE		
2	PV ARRAY		
3	J-BOX (IF USED)		
4	COMBINER (IF USED)		
5	DC DISCONNECT		
6	DC/AC INVERTER		
7	GEN METER (IF USED)		
8	AC DISCONNECT (IF USED)		
9	SERVICE PANEL		_____VAC, _____A MAIN, _____A BUS, _____A INVERTER OCPD
			(SEE NOTE 5 FOR INVERTER OCPDs, ALSO SEE GUIDE SECTION 9)

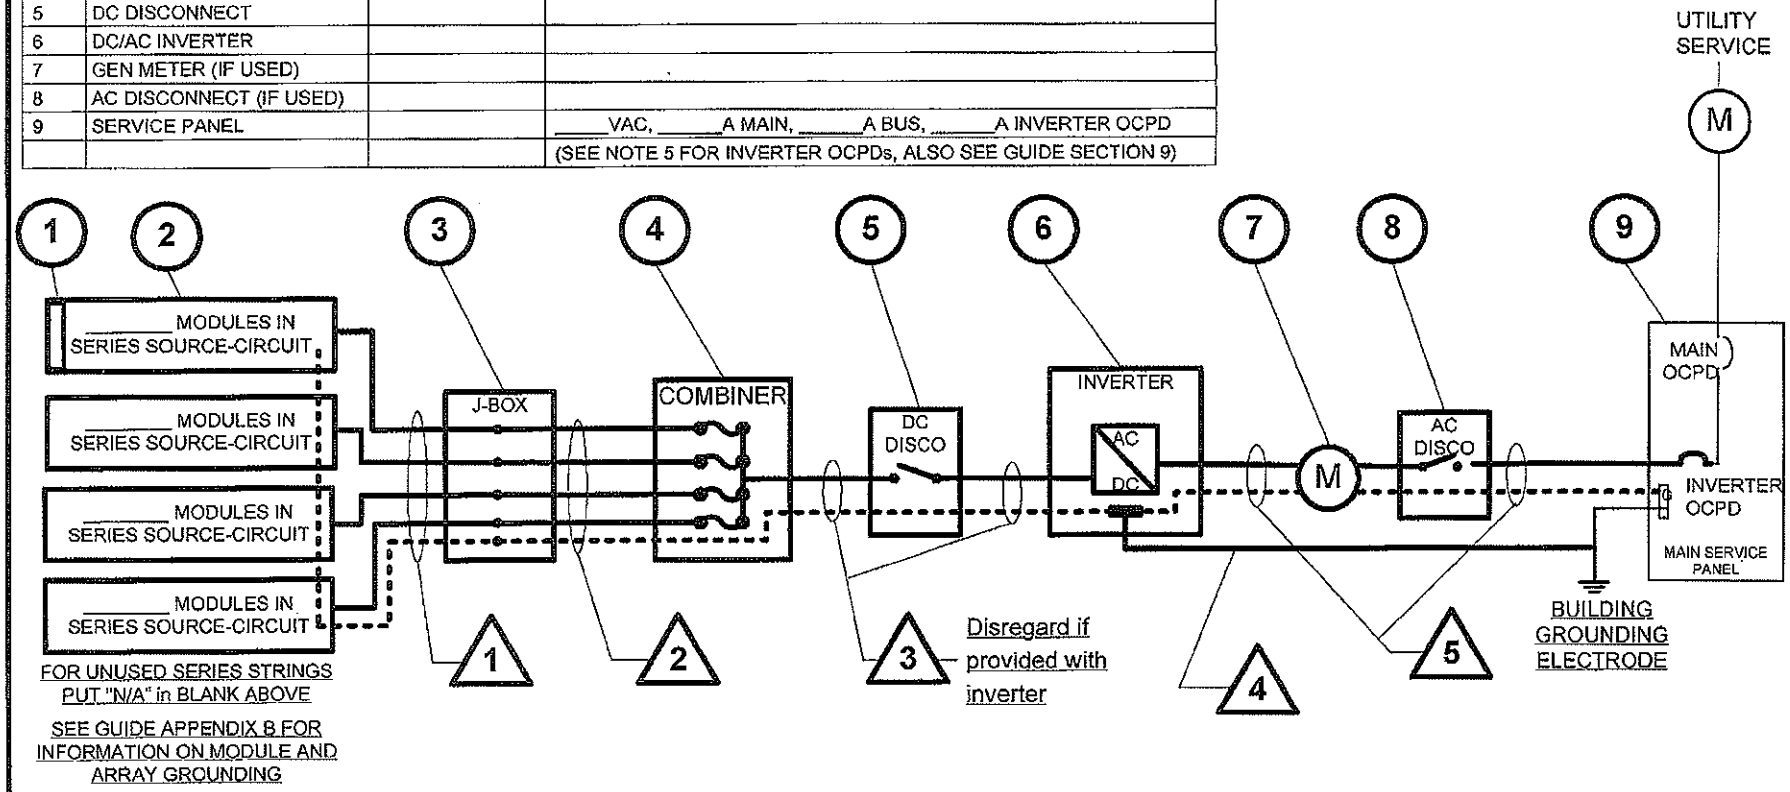

CONDUIT AND CONDUCTOR SCHEDULE					
TAG	DESCRIPTION OR CONDUCTOR TYPE	COND. GAUGE	NUMBER OF CONDUCTORS	CONDUIT TYPE	CONDUIT SIZE
1	USE-2 ☐ or PV WIRE ☐			N/A	N/A
	BARE COPPER EQ. GRD. COND. (EGC)			N/A	N/A
2	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
3	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	INSULATED EGC				
4	DC GROUNDING ELECTRODE COND.				
5	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	INSULATED EGC				

Contractor Name, Address and Phone:

_____
_____
_____
_____

Drawn By:

Checked By:

One-Line Standard Electrical Diagram for Small-Scale, Single-Phase PV Systems

Site Name: _____

Site Address: _____

System AC Size: _____

SIZE	FSCM NO	DWG NO	REV
		E1.1	
SCALE NTS	Date:	SHEET	

SINGLE PHASE NOTES

PV MODULE RATINGS @ STC (Guide Section 5)

MODULE MAKE	
MODULE MODEL	
MAX POWER-POINT CURRENT (I_{MP})	A
MAX POWER-POINT VOLTAGE (V_{MP})	V
OPEN-CIRCUIT VOLTAGE (V_{OC})	V
SHORT-CIRCUIT CURRENT (I_{SC})	A
MAX SERIES FUSE (OCPD)	A
MAXIMUM POWER (P_{MAX})	W
MAX VOLTAGE (TYP 600V_{DC})	V
VOC TEMP COEFF (mV/°C☐ or %/°C☐)	
IF COEFF SUPPLIED, CIRCLE UNITS	

NOTES FOR ALL DRAWINGS:

OCPD = OVERCURRENT PROTECTION DEVICE

NATIONAL ELECTRICAL CODE® REFERENCES SHOWN AS *(NEC XXX.XX)*

INVERTER RATINGS (Guide Section 4)

INVERTER MAKE	
INVERTER MODEL	
MAX DC VOLT RATING	V
MAX POWER @ 40°C	W
NOMINAL AC VOLTAGE	V
MAX AC CURRENT	A
MAX OCPD RATING	A

SIGNS–SEE GUIDE SECTION 7

SIGN FOR DC DISCONNECT

PHOTOVOLTAIC POWER SOURCE	
RATED MPP CURRENT	A
RATED MPP VOLTAGE	V
MAX SYSTEM VOLTAGE	V
MAX CIRCUIT CURRENT	A
WARNING: ELECTRICAL SHOCK HAZARD–LINE AND LOAD MAY BE ENERGIZED IN OPEN POSITION	

SIGN FOR INVERTER OCPD AND AC DISCONNECT (IF USED)

SOLAR PV SYSTEM AC POINT OF CONNECTION	
AC OUTPUT CURRENT	A
NOMINAL AC VOLTAGE	V
THIS PANEL FED BY MULTIPLE SOURCES (UTILITY AND SOLAR)	

NOTES FOR ARRAY CIRCUIT WIRING (Guide Section 6 and 8 and Appendix D):

1.) LOWEST EXPECT AMBIENT TEMPERATURE BASED ON ASHRAE MINIMUM MEAN EXTREME DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. LOWEST EXPECTED AMBIENT TEMP _____°C

2.) HIGHEST CONTINUOUS AMBIENT TEMPERATURE BASED ON ASHRAE HIGHEST MONTH 2% DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. HIGHEST CONTINUOUS TEMPERATURE _____°C

2.) 2005 ASHRAE FUNDEMENTALS 2% DESIGN TEMPERATURES DO NOT EXCEED 47°C IN THE UNITED STATES (PALM SPRINGS, CA IS 44.1°C). FOR LESS THAN 9 CURRENT-CARRYING CONDUCTORS IN ROOF-MOUNTED SUNLIT CONDUIT AT LEAST 0.5" ABOVE ROOF AND USING THE OUTDOOR DESIGN TEMPERATURE OF 47°C OR LESS (ALL OF UNITED STATES),

a) 12 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR MODULES WITH Isc OF 7.68 AMPS OR LESS WHEN PROTECTED BY A 12-AMP OR SMALLER FUSE.
b) 10 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR MODULES WITH Isc OF 9.6 AMPS OR LESS WHEN PROTECTED BY A 15-AMP OR SMALLER FUSE.

NOTES FOR INVERTER CIRCUITS (Guide Section 8 and 9):

1) IF UTILITY REQUIRES A VISIBLE-BREAK SWITCH, DOES THIS SWITCH MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

2) IF GENERATION METER REQUIRED, DOES THIS METER SOCKET MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

3) SIZE PHOTOVOLTAIC POWER SOURCE (DC) CONDUCTORS BASED ON MAX CURRENT ON NEC 690.53 SIGN OR OCPD RATING AT DISCONNECT

4) SIZE INVERTER OUTPUT CIRCUIT (AC) CONDUCTORS ACCORDING TO INVERTER OCPD AMPERE RATING. (See Guide Section 9)

5) TOTAL OF _____ INVERTER OCPD(s), ONE FOR EACH INVERTER. DOES TOTAL SUPPLY BREAKERS COMPLY WITH 120% BUSBAR EXCEPTION IN 690.64(B)(2)(a)? YES ☐ NO ☐

Contractor Name, Address and Phone: _____	Notes for One-Line Standard Electrical Diagram for Single-Phase PV Systems			
	Site Name: _____			
	Site Address: _____			
	System AC Size: _____			
Drawn By:	SIZE	FSCM NO	DWG NO E1.2	REV
Checked By:	SCALE NTS	Date:	SHEET	

Micro-Inverter Electrical Diagram

EQUIPMENT SCHEDULE			
TAG	DESCRIPTION	PART NUMBER	NOTES
1	PV DC or AC MODULE		
2	DC/AC INVERTER (MICRO)		
3	J-BOX (IF USED)		
4	PV ARRAY		
5	AC COMB. PANEL (IF USED)		
6	GEN METER (IF USED)		
7	AC DISCONNECT (IF USED)		
8	SERVICE PANEL		

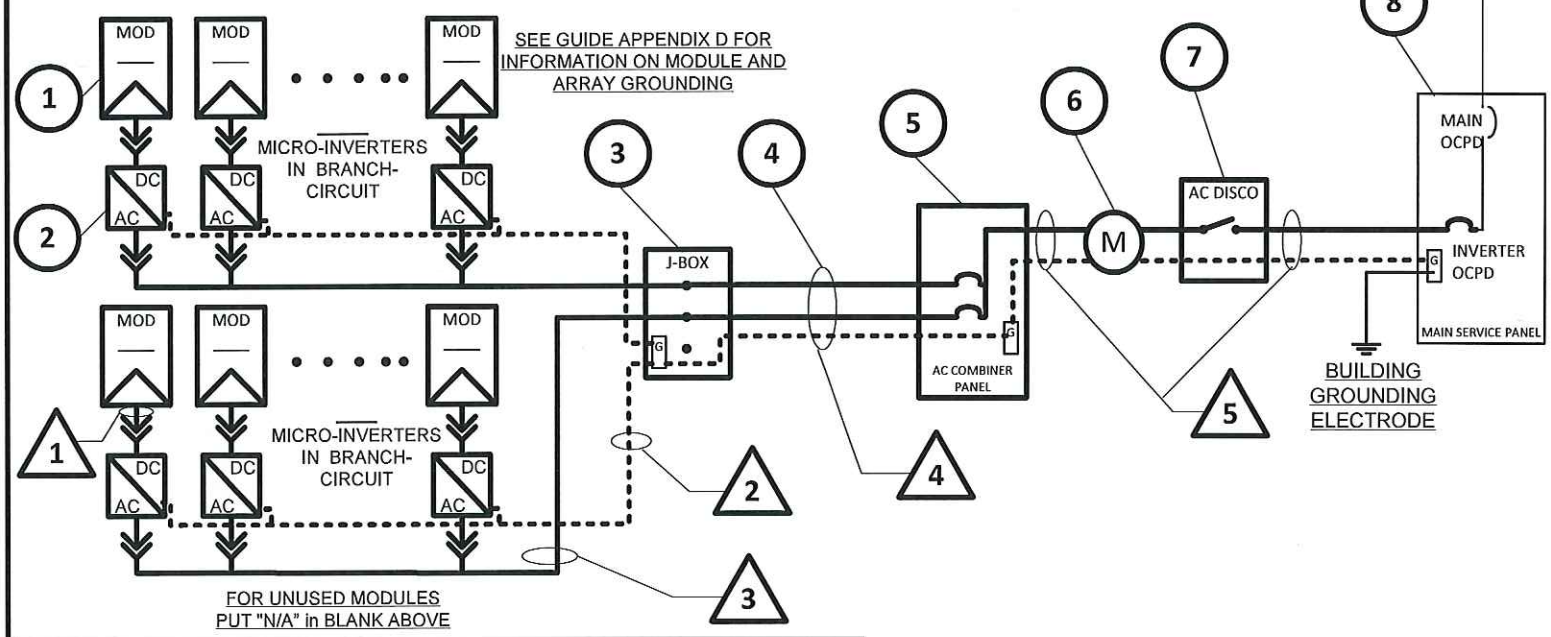

CONDUIT AND CONDUCTOR SCHEDULE					
TAG	DESCRIPTION OR CONDUCTOR TYPE	COND. GAUGE	NUMBER OF CONDUCTORS	CONDUIT TYPE	CONDUIT SIZE
1	USE-2 ☐ or PV WIRE ☐	MFG	MFG Cable	N/A	N/A
2	GEC ☐ EGC ☐ X ALL THAT APPLY			N/A	N/A
3	EXTERIOR CABLE LISTED W/ INV.	MFG	MFG Cable	N/A	N/A
4	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	GEC ☐ EGC ☐ X ALL THAT APPLY			SAME	SAME
	NO DC GEC IF 690.35 SYSTEM				
5	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	GEC ☐ EGC ☐ X ALL THAT APPLY			SAME	SAME

Contractor Name, Address and Phone:	One-Line Standard Electrical Diagram for Micro-Inverter PV Systems Site Name: Site Address: System AC Size:			
Drawn By:	SIZE	FSCM NO	DWG NO	REV
Checked By:	SCALE NTS	Date:	SHEET	

NOTES FOR MICRO-INVERTER ELECTRICAL DIAGRAM

PV MODULE RATINGS @ STC (Guide Section 5)

MODULE MAKE	
MODULE MODEL	
MAX POWER-POINT CURRENT (I_{MP})	
MAX POWER-POINT VOLTAGE (V_{MP})	
OPEN-CIRCUIT VOLTAGE (V_{OC})	
SHORT-CIRCUIT CURRENT (I_{SC})	
MAX SERIES FUSE (OCPD)	
MAXIMUM POWER (P_{MAX})	
MAX VOLTAGE (TYP 600V_{DC})	
VOC TEMP COEFF (mV/°C ☐ or %/°C ☐)	
IF COEFF SUPPLIED, CIRCLE UNITS	

NOTES FOR ALL DRAWINGS:

OCPD = OVERCURRENT PROTECTION DEVICE

NATIONAL ELECTRICAL CODE® REFERENCES SHOWN AS *(NEC XXX.XX)*

INVERTER RATINGS (Guide Section 4)

INVERTER MAKE	
INVERTER MODEL	
MAX DC VOLT RATING	
MAX POWER @ 40°C	
NOMINAL AC VOLTAGE	
MAX AC CURRENT	
MAX OCPD RATING	

SIGNS–SEE GUIDE SECTION 7

SIGN FOR DC DISCONNECT

No sign necessary since 690.51 marking on PV module covers needed information

SIGN FOR INVERTER OCPD AND AC DISCONNECT (IF USED)

SOLAR PV SYSTEM AC POINT OF CONNECTION	
AC OUTPUT CURRENT	
NOMINAL AC VOLTAGE	
THIS PANEL FED BY MULTIPLE SOURCES (UTILITY AND SOLAR)	

NOTES FOR ARRAY CIRCUIT WIRING (Guide Section 6 and 8 and Appendix E):

1.) LOWEST EXPECT AMBIENT TEMPERATURE BASED ON ASHRAE MINIMUM MEAN EXTREME DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. LOWEST EXPECTED AMBIENT TEMP ____°C

2.) HIGHEST CONTINUOUS AMBIENT TEMPERATURE BASED ON ASHRAE HIGHEST MONTH 2% DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. HIGHEST CONTINUOUS TEMPERATURE ____°C

2.) 2009 ASHRAE FUNDAMENTALS 2% DESIGN TEMPERATURES DO NOT EXCEED 47°C IN THE UNITED STATES (PALM SPRINGS, CA IS 44.1°C). FOR LESS THAN 9 CURRENT-CARRYING CONDUCTORS IN ROOF-MOUNTED SUNLIT CONDUIT AT LEAST 0.5" ABOVE ROOF AND USING THE OUTDOOR DESIGN TEMPERATURE OF 47°C OR LESS (ALL OF UNITED STATES),

a) 12 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR MODULES WITH Isc OF 7.68 AMPS OR LESS WHEN PROTECTED BY A 12-AMP OR SMALLER FUSE.
b) 10 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR MODULES WITH Isc OF 9.6 AMPS OR LESS WHEN PROTECTED BY A 15-AMP OR SMALLER FUSE.

NOTES FOR INVERTER CIRCUITS (Guide Section 8 and 9):

1) IF UTILITY REQUIRES A VISIBLE-BREAK SWITCH, DOES THIS SWITCH MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

2) IF GENERATION METER REQUIRED, DOES THIS METER SOCKET MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

3) SIZE PHOTOVOLTAIC POWER SOURCE (DC) CONDUCTORS BASED ON MAX CURRENT ON NEC 690.53 SIGN OR OCPD RATING AT DISCONNECT

4) SIZE INVERTER OUTPUT CIRCUIT (AC) CONDUCTORS ACCORDING TO INVERTER OCPD AMPERE RATING. (See Guide Section 9)

5) TOTAL OF _____ INVERTER OUTPUT CIRCUIT OCPD(s), ONE FOR EACH MICRO-INVERTER CIRCUIT. DOES TOTAL SUPPLY BREAKERS COMPLY WITH 120% BUSBAR EXCEPTION IN 690.64(B)(2)(a)? YES ☐ NO ☐

Contractor Name, Address and Phone:	Notes for One-Line Standard Electrical Diagram for Single-Phase PV Systems Site Name: Site Address: System AC Size:			
Drawn By:	SIZE	FSCM NO	DWG NO	REV
Checked By:	SCALE NTS	Date:	SHEET	

AC Module Electrical Diagram

EQUIPMENT SCHEDULE			
TAG	DESCRIPTION	PART NUMBER	NOTES
1			
2			
3			
4			
5			
6			
7			

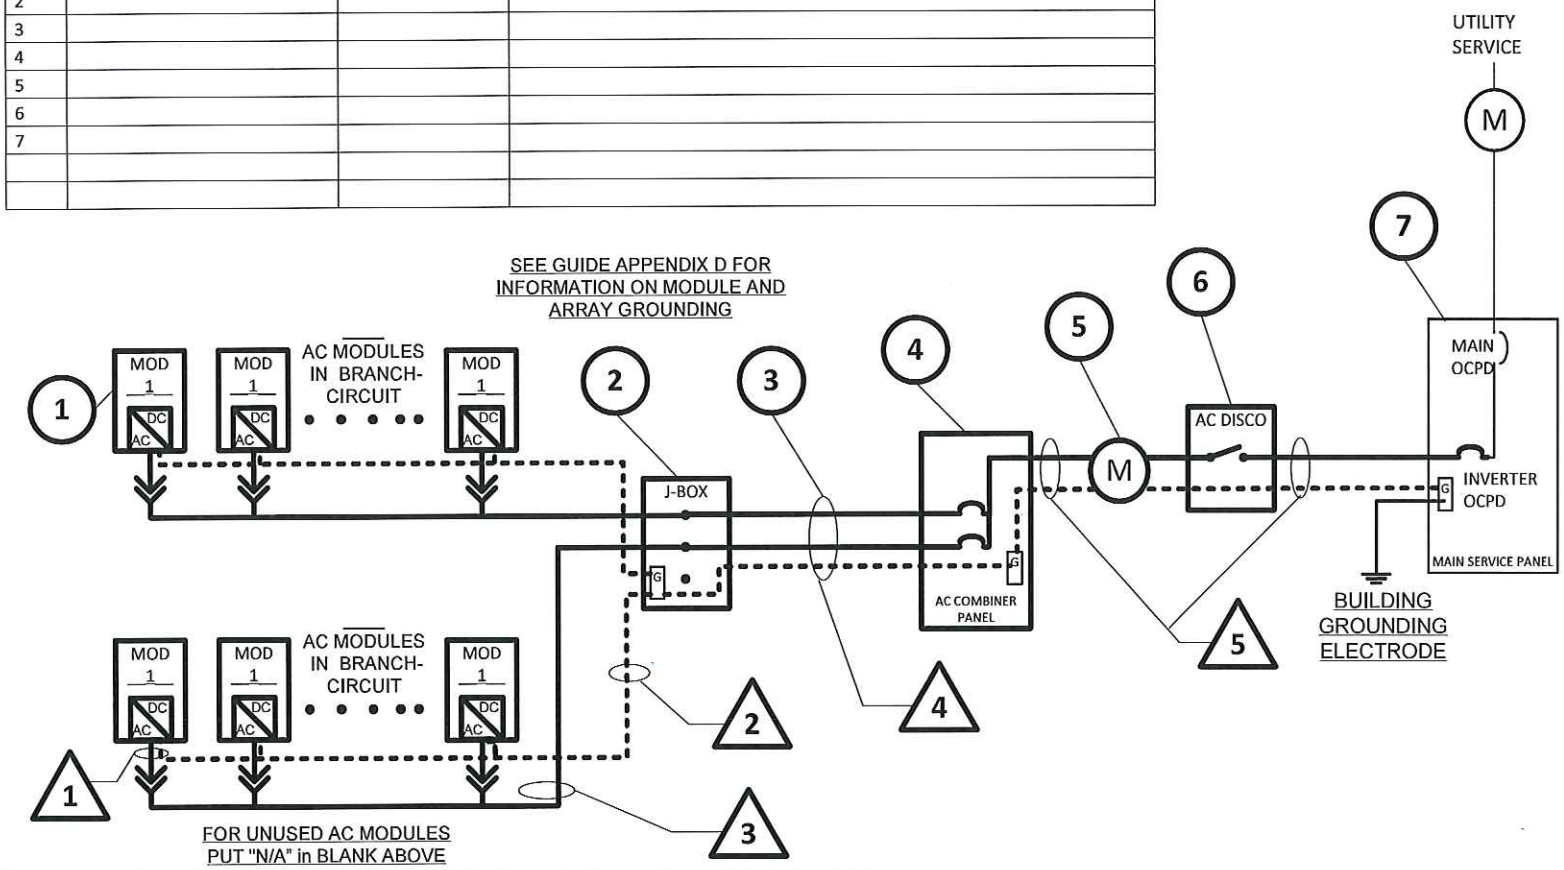

CONDUIT AND CONDUCTOR SCHEDULE					
TAG	DESCRIPTION OR CONDUCTOR TYPE	COND. GAUGE	NUMBER OF CONDUCTORS	CONDUIT TYPE	CONDUIT SIZE
1	USE-2 ☐ or PV WIRE ☐	MFG	MFG Cable	N/A	N/A
2	GEC ☐ EGC ☐ X ALL THAT APPLY			N/A	N/A
3	EXTERIOR CABLE LISTED W/ INV.	MFG	MFG Cable	N/A	N/A
4	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	GEC ☐ EGC ☐ X ALL THAT APPLY				
	NO DC GEC IF 690.35 SYSTEM				
5	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	GEC ☐ EGC ☐ X ALL THAT APPLY				

Contractor Name, Address and Phone:	One-Line Standard Electrical Diagram for AC Module PV Systems			
	Site Name:			
	Site Address:			
	System AC Size:			
Drawn By:	SIZE	FSCM NO	DWG NO	REV
Checked By:	SCALE NTS	Date:	SHEET	

Notes for AC Module Electrical Diagram

NOTES FOR ALL DRAWINGS:

OCPD = OVERCURRENT PROTECTION DEVICE

NATIONAL ELECTRICAL CODE® REFERENCES SHOWN AS *(NEC XXX.XX)*

AC MODULE RATINGS (Guide Appendix C)

AC MODULE MAKE	
AC MODULE MODEL	
NOMINAL OPERATING AC VOLTAGE	
NOMINAL OPERATING AC FREQUENCY	
MAXIMUM AC POWER	
MAXIMUM AC CURRENT	
MAXIMUM OCPD RATING	

SIGNS–SEE GUIDE SECTION 7

SIGN FOR DC DISCONNECT

N/A since no dc wiring

SIGN FOR INVERTER OCPD AND AC DISCONNECT (IF USED)

SOLAR PV SYSTEM AC POINT OF CONNECTION	
AC OUTPUT CURRENT	
NOMINAL AC VOLTAGE	
THIS PANEL FED BY MULTIPLE SOURCES (UTILITY AND SOLAR)	

NOTES FOR ARRAY CIRCUIT WIRING (Guide Section 6 and 8 and Appendix F):

1.) LOWEST EXPECT AMBIENT TEMPERATURE BASED ON ASHRAE MINIMUM MEAN EXTREME DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. LOWEST EXPECTED AMBIENT TEMP ____°C

2.) HIGHEST CONTINUOUS AMBIENT TEMPERATURE BASED ON ASHRAE HIGHEST MONTH 2% DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. HIGHEST CONTINUOUS TEMPERATURE ___°C

2.) 2009 ASHRAE FUNDAMENTALS 2% DESIGN TEMPERATURES DO NOT EXCEED 47°C IN THE UNITED STATES (PALM SPRINGS, CA IS 44.1°C). FOR 6 OR LESS CURRENT-CARRYING CONDUCTORS IN ROOF-MOUNTED SUNLIT CONDUIT AT LEAST 0.5" ABOVE ROOF AND USING THE OUTDOOR DESIGN TEMPERATURE OF 47°C OR LESS (ALL OF UNITED STATES),

a) 12 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR AC MODULES INVERTER OUTPUT CIRCUITS WITH 12 AMPS OR LESS WHEN PROTECTED BY A 15-AMP OR SMALLER OCPD.

b) 10 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR AC MODULES INVERTER OUTPUT CIRCUITS WITH 16 AMPS OR LESS WHEN PROTECTED BY A 20-AMP OR SMALLER OCPD.

NOTES FOR INVERTER CIRCUITS (Guide Section 8 and 9):

1) IF UTILITY REQUIRES A VISIBLE-BREAK SWITCH, DOES THIS SWITCH MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

2) IF GENERATION METER REQUIRED, DOES THIS METER SOCKET MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

3) SIZE PHOTOVOLTAIC POWER SOURCE (DC) CONDUCTORS BASED ON MAX CURRENT ON NEC 690.53 SIGN OR OCPD RATING AT DISCONNECT (N/A)

4) SIZE INVERTER OUTPUT CIRCUIT (AC) CONDUCTORS ACCORDING TO INVERTER OCPD AMPERE RATING. (See Guide Section 9)

5) TOTAL OF _____ INVERTER OUTPUT CIRCUIT OCPD(s), ONE FOR EACH AC MODULE CIRCUIT. DOES TOTAL SUPPLY BREAKERS COMPLY WITH 120% BUSBAR EXCEPTION IN 690.64(B)(2)(a)? YES ☐ NO ☐

Contractor Name, Address and Phone:	Notes for One-Line Standard Electrical Diagram for Single-Phase PV Systems Site Name: Site Address: System AC Size:				
Drawn By:	SIZE	FSCM NO	DWG NO		REV
Checked By:	SCALE	NTS	Date:	SHEET	

Supply-Side Connection Electrical Diagram

EQUIPMENT SCHEDULE			
TAG	DESCRIPTION	PART NUMBER	NOTES
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			

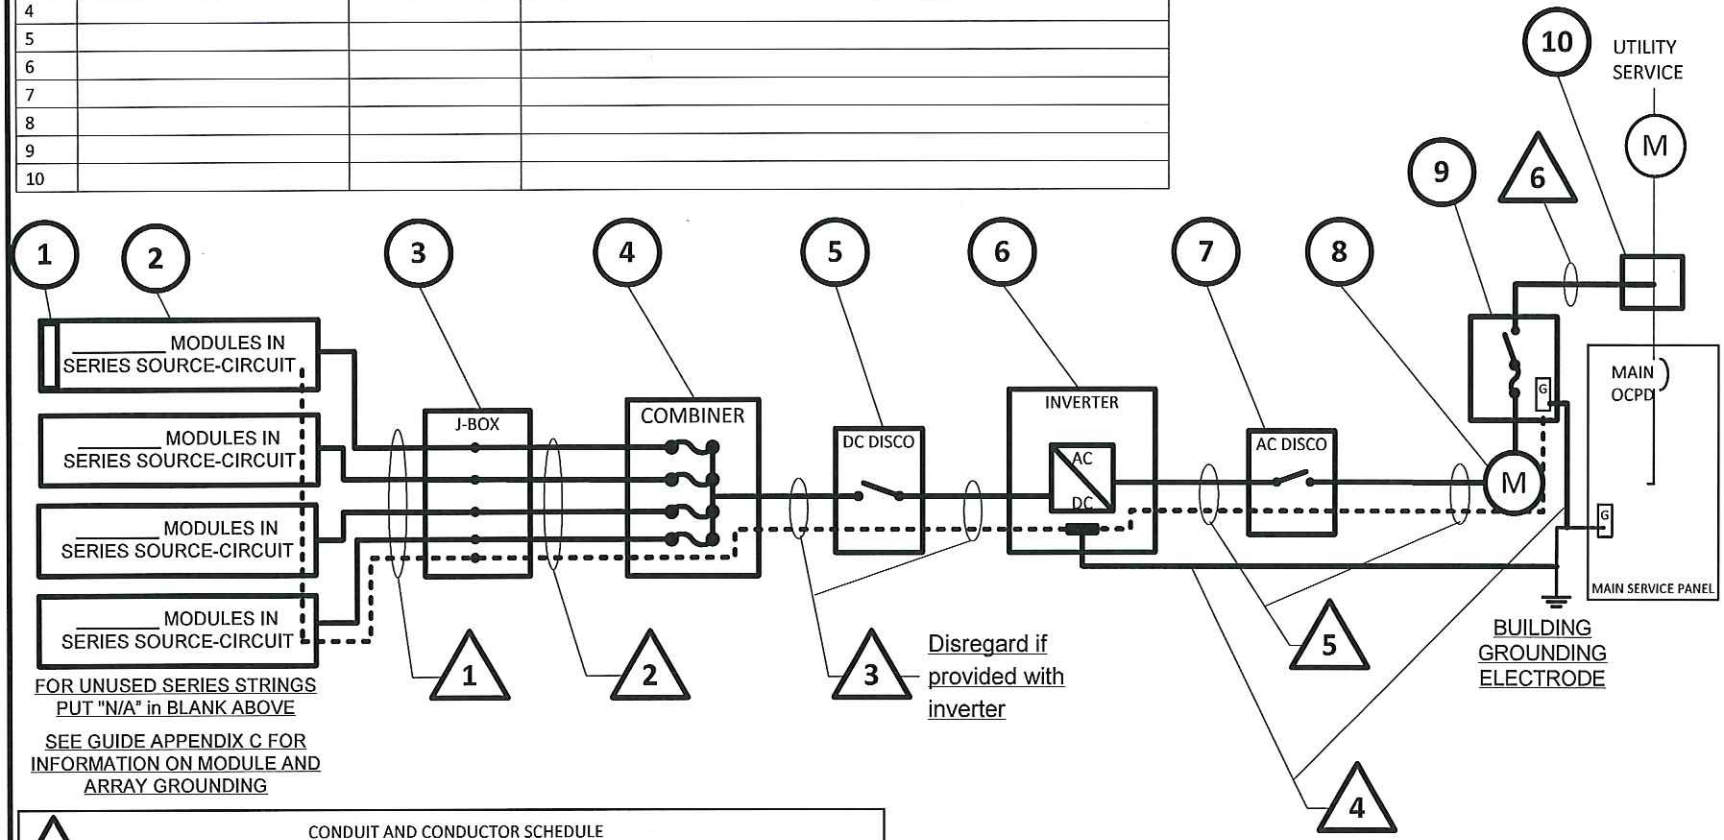

CONDUIT AND CONDUCTOR SCHEDULE					
TAG	DESCRIPTION OR CONDUCTOR TYPE	COND. GAUGE	NUMBER OF CONDUCTORS	CONDUIT TYPE	CONDUIT SIZE
1	USE-2 ☐ or PV WIRE ☐				
	BARE COPPER EQ. GRD. COND. (EGC)				
2	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
3	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	INSULATED EGC				
4	GROUNDING ELECTRODE COND.				
5	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				
	INSULATED EGC				
6	THWN-2 ☐ or XHHW-2 ☐ or RHW-2 ☐				

Contractor Name, Address and Phone:	One-Line Electrical Diagram for Supply-Side Connected Single-Phase PV Systems Site Name: Site Address: System AC Size:			
Drawn By:	SIZE	FSCM NO	DWG NO	REV
Checked By:	SCALE NTS	Date:	SHEET	

Notes for Supply-Side Connection Electrical Diagram

PV MODULE RATINGS @ STC (Guide Section 5)

MODULE MAKE	
MODULE MODEL	
MAX POWER-POINT CURRENT (I_{MP})	A
MAX POWER-POINT VOLTAGE (V_{MP})	V
OPEN-CIRCUIT VOLTAGE (V_{OC})	V
SHORT-CIRCUIT CURRENT (I_{SC})	A
MAX SERIES FUSE (OCPD)	A
MAXIMUM POWER (P_{MAX})	W
MAX VOLTAGE (TYP 600V_{DC})	V
VOC TEMP COEFF (mV/°C ☐ or %/°C ☐)	
IF COEFF SUPPLIED, CIRCLE UNITS	

NOTES FOR ALL DRAWINGS:

OCPD = OVERCURRENT PROTECTION DEVICE

NATIONAL ELECTRICAL CODE® REFERENCES SHOWN AS *(NEC XXX.XX)*

INVERTER RATINGS (Guide Section 4)

INVERTER MAKE	
INVERTER MODEL	
MAX DC VOLT RATING	V
MAX POWER @ 40°C	W
NOMINAL AC VOLTAGE	V
MAX AC CURRENT	A
MAX OCPD RATING	A

SIGNS–SEE GUIDE SECTION 7

SIGN FOR DC DISCONNECT

PHOTOVOLTAIC POWER SOURCE	
RATED MPP CURRENT	A
RATED MPP VOLTAGE	V
MAX SYSTEM VOLTAGE	V
MAX CIRCUIT CURRENT	A
WARNING: ELECTRICAL SHOCK HAZARD–LINE AND LOAD MAY BE ENERGIZED IN OPEN POSITION	

SIGN FOR INVERTER OCPD AND AC DISCONNECT (IF USED)

SOLAR PV SYSTEM AC POINT OF CONNECTION	
AC OUTPUT CURRENT	A
NOMINAL AC VOLTAGE	V
THIS PANEL FED BY MULTIPLE SOURCES (UTILITY AND SOLAR)	

NOTES FOR ARRAY CIRCUIT WIRING (Guide Section 6 and 8 and Appendix D):

1.) LOWEST EXPECT AMBIENT TEMPERATURE BASED ON ASHRAE MINIMUM MEAN EXTREME DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. LOWEST EXPECTED AMBIENT TEMP _____°C

2.) HIGHEST CONTINUOUS AMBIENT TEMPERATURE BASED ON ASHRAE HIGHEST MONTH 2% DRY BULB TEMPERATURE FOR ASHRAE LOCATION MOST SIMILAR TO INSTALLATION LOCATION. HIGHEST CONTINUOUS TEMPERATURE _____°C

2.) 2005 ASHRAE FUNDEMENTALS 2% DESIGN TEMPERATURES DO NOT EXCEED 47°C IN THE UNITED STATES (PALM SPRINGS, CA IS 44.1°C). FOR LESS THAN 9 CURRENT-CARRYING CONDUCTORS IN ROOF-MOUNTED SUNLIT CONDUIT AT LEAST 0.5" ABOVE ROOF AND USING THE OUTDOOR DESIGN TEMPERATURE OF 47°C OR LESS (ALL OF UNITED STATES),

a) 12 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR MODULES WITH Isc OF 7.68 AMPS OR LESS WHEN PROTECTED BY A 12-AMP OR SMALLER FUSE.
b) 10 AWG, 90°C CONDUCTORS ARE GENERALLY ACCEPTABLE FOR MODULES WITH Isc OF 9.6 AMPS OR LESS WHEN PROTECTED BY A 15-AMP OR SMALLER FUSE.

NOTES FOR INVERTER CIRCUITS (Guide Section 8 and 9):

1) IF UTILITY REQUIRES A VISIBLE-BREAK SWITCH, DOES THIS SWITCH MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

2) IF GENERATION METER REQUIRED, DOES THIS METER SOCKET MEET THE REQUIREMENT? YES ☐ NO ☐ N/A ☐

3) SIZE PHOTOVOLTAIC POWER SOURCE (DC) CONDUCTORS BASED ON MAX CURRENT ON NEC 690.53 SIGN OR OCPD RATING AT DISCONNECT

4) SIZE INVERTER OUTPUT CIRCUIT (AC) CONDUCTORS ACCORDING TO INVERTER OCPD AMPERE RATING. (See Guide Section 9)

5) TOTAL OF _____ INVERTER OCPD(s), ONE FOR EACH INVERTER. DOES TOTAL SUPPLY BREAKERS COMPLY WITH 120% BUSBAR EXCEPTION IN 690.64(B)(2)(a)? YES ☐ NO ☐

Contractor Name, Address and Phone: _____	Notes for One-Line Standard Electrical Diagram for Single-Phase PV Systems Site Name: _____ Site Address: _____ System AC Size: _____			
Drawn By:	SIZE	FSCM NO	DWG NO	REV
Checked By:	SCALE NTS	Date:	SHEET	